

# AC axial fan

sickled blades (S series)  
with guard grille for short nozzle

## ASIA PACIFIC SHENGRUI LIMITED

Phone +00852 56261528  
info@apacfan.com  
www.apacfan.com

### Nominal data

<b>Type</b>	S4D450-AU01-01				
<b>Motor</b>	M4D094-EA				
Phase		3~	3~	3~	3~
Nominal voltage	V	400	400	400	400
Connection		D	Y	D	Y
Frequency	Hz	50	50	60	60
Type of data definition		ml	ml	ml	ml
Valid for approval / standard		CE	CE	CE	CE
Speed	min <sup>-1</sup>	1250	875	1360	860
Power input	W	340	200	415	205
Current draw	A	0.61	0.33	0.70	0.35
Max. back pressure	Pa	120	60	85	35
Max. ambient temperature	°C	60	60	60	60

ml = max. load · me = max. efficiency · rfa = running at free air · cs = customer specs · cu = customer unit  
Subject to alterations

# AC axial fan

sickled blades (S series)  
with guard grille for short nozzle


## Technical features

Leakage current	<= 3.5 mA
Size	450 mm
Operation mode	S1
Direction of rotation	Counter-clockwise, seen on rotor
Mounting position	Shaft horizontal or rotor on bottom; rotor on top on request
Electrical leads	Via terminal box
Humidity class	F4-1
Direction of air flow	"V"
Insulation class	"F"
Condensate discharge holes	Rotor-side
Motor bearing	Ball bearing
Mass	7.2 kg
Material of terminal box	ABS plastic, black
Material of impeller	PP-GF40 plastic
Material of guard grille	Steel, phosphated and coated in black plastic
Motor protection	Thermal overload protector (TOP) brought out
Product conforming to standard	CE; EN 60034-1 (2004)
Surface of rotor	Coated in black
Number of blades	5
Type of protection	IP 54
Protection class	I
Max. permissible ambient motor temp. (transp./ storage)	+80 °C
Min. permissible ambient motor temp. (transp./storage)	-40 °C

# AC axial fan

sickled blades (S series)  
with guard grille for short nozzle

## Product drawing

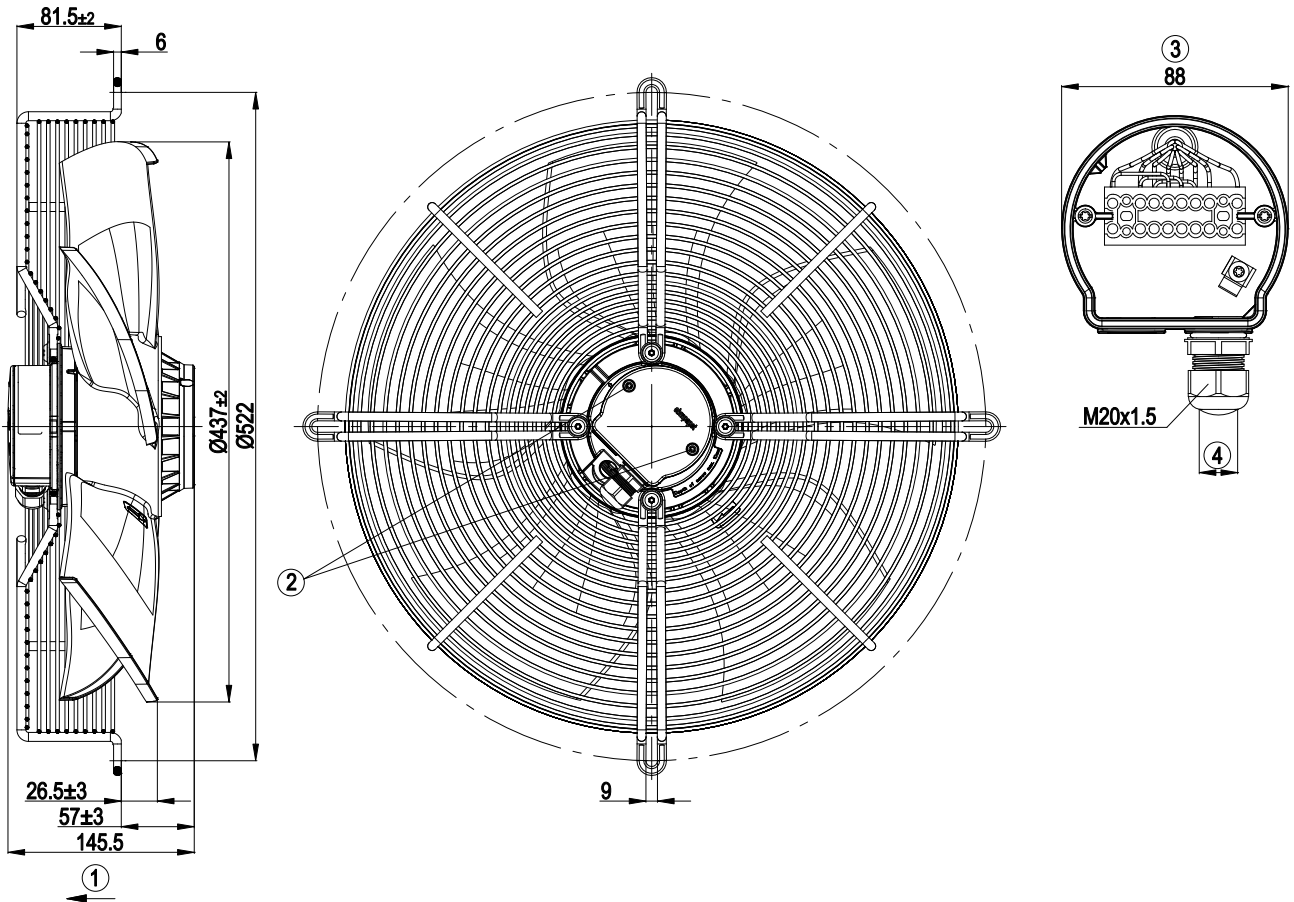


1	Direction of air flow "V"
2	Tightening torque 1.5 Nm ± 0.2 Nm
3	Illustration without terminal box cover
4	Cable diameter: min. 6 mm, max. 12 mm; tightening torque: 2Nm ± 0.2Nm

# AC axial fan

sickled blades (S series)  
with guard grille for short nozzle

## Connection screen

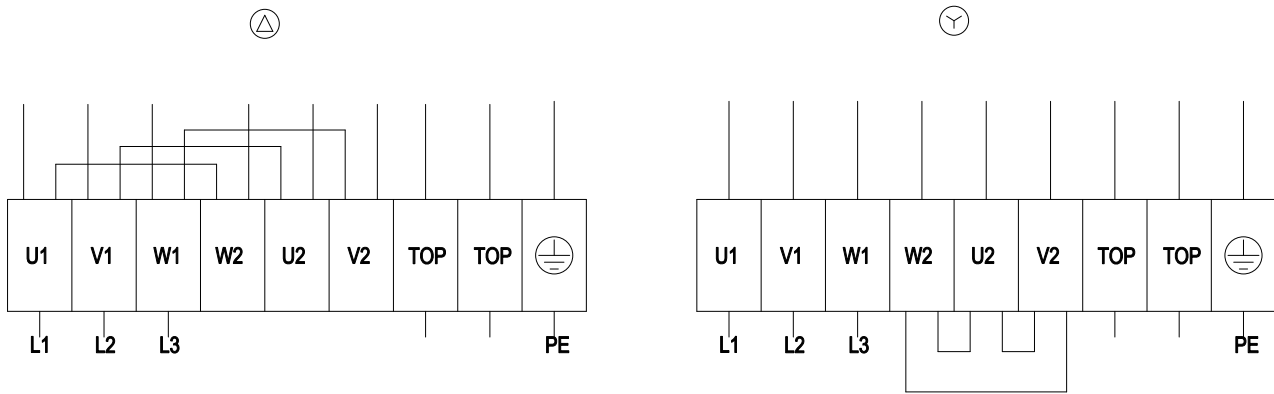


Note: Direction of rotation changes when two phases are reversed

Δ	Delta-connection	Y	Star connection	L1	= U1 = black
L2	= V1 = blue	L3	= W1 = brown	W2	yellow
U2	green	V2	white	TOP	2 x grey
PE	green / yellow				

# AC axial fan

sickled blades (S series)  
with guard grille for short nozzle

## Charts: Air flow 50 Hz $\Delta$

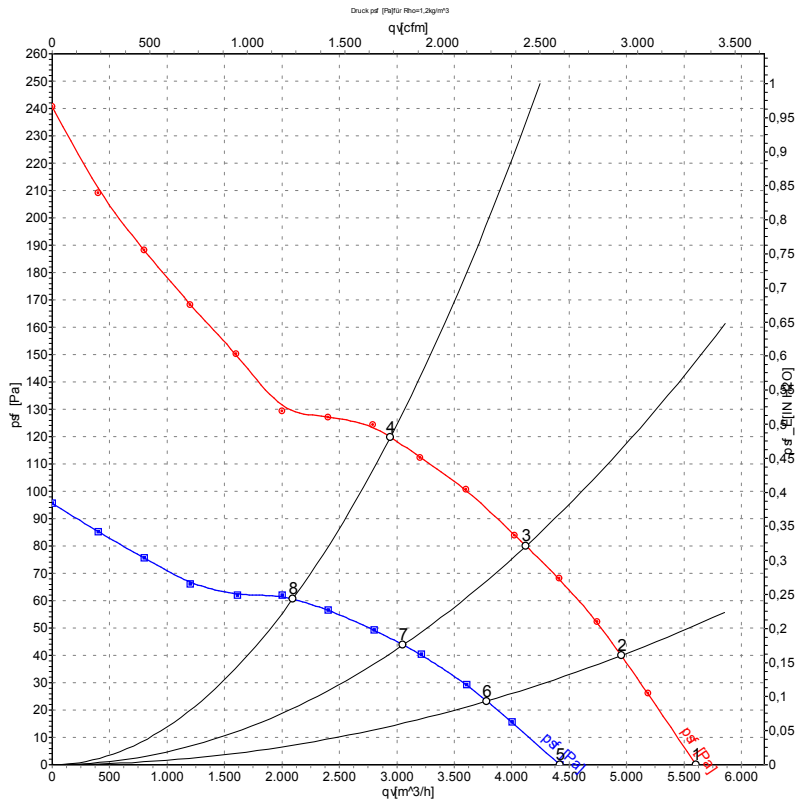

Measurement: LU-72632  
Measurement: LU-72634

Air performance measured as per ISO 5801 Installation Category A. For detailed information on the measuring set-up, please contact ebm-papst. Suction-side noise levels: L<sub>wA</sub> measured as per ISO 13347 / L<sub>pA</sub> measured with 1m distance to fan axis. The values given are valid under the measuring conditions mentioned above and may vary according to the actual installation situation. With any deviation from the standard set-up, the specific values have to be checked and reviewed with the unit installed.


## Measured values

	Conn.	U	f	n	P <sub>1</sub>	I	q <sub>v</sub>	p <sub>sf</sub>
		V	Hz	min <sup>-1</sup>	W	A	m³/h	Pa
1	$\Delta$	400	50	1350	231	0.49	5605	0
2	$\Delta$	400	50	1320	262	0.52	4955	40
3	$\Delta$	400	50	1300	289	0.55	4125	80
4	$\Delta$	400	50	1250	340	0.61	2945	120
5	Y	400	50	1070	160	0.27	4420	0
6	Y	400	50	1015	172	0.29	3785	23
7	Y	400	50	970	182	0.31	3055	44
8	Y	400	50	875	200	0.33	2095	61

# AC axial fan

sickled blades (S series)  
with guard grille for short nozzle

## Charts: Air flow 60 Hz $\Delta$

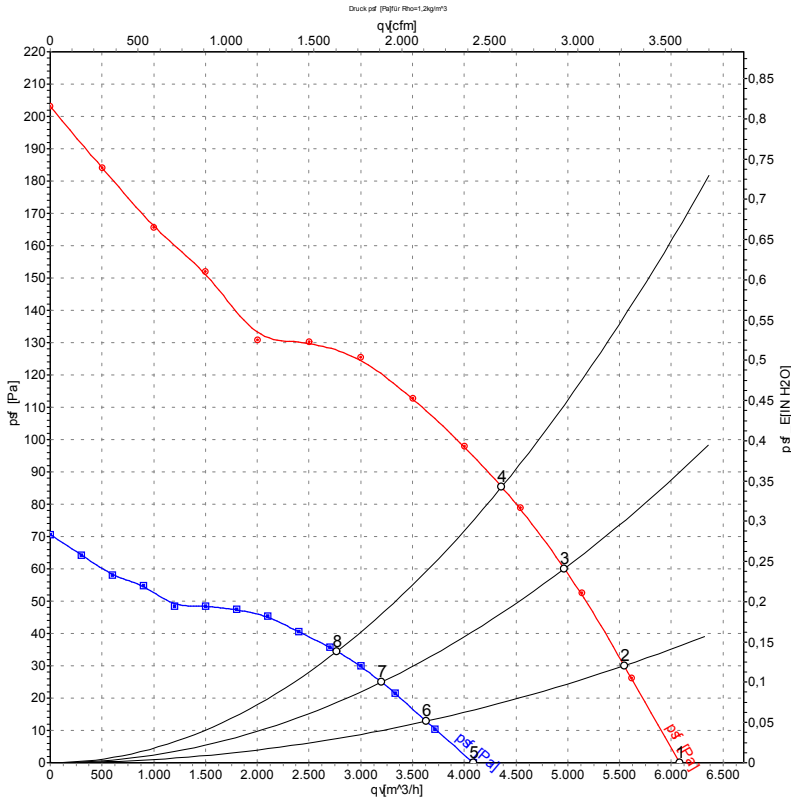

Measurement: LU-72642  
Measurement: LU-72646

Air performance measured as per ISO 5801 Installation Category A. For detailed information on the measuring set-up, please contact ebm-papst. Suction-side noise levels: LwA measured as per ISO 13347 / LpA measured with 1m distance to fan axis. The values given are valid under the measuring conditions mentioned above and may vary according to the actual installation situation. With any deviation from the standard set-up, the specific values have to be checked and reviewed with the unit installed.

## Measured values

	Conn.	U	f	n	P <sub>1</sub>	I	qv	P <sub>sf</sub>
		V	Hz	min <sup>-1</sup>	W	A	m <sup>3</sup> /h	Pa
1	$\Delta$	400	60	1455	334	0.57	6085	0
2	$\Delta$	400	60	1415	359	0.61	5545	30
3	$\Delta$	400	60	1380	381	0.64	4965	60
4	$\Delta$	400	60	1360	415	0.70	4360	85
5	Y	400	60	990	187	0.31	4090	0
6	Y	400	60	940	192	0.32	3630	13
7	Y	400	60	900	197	0.33	3200	25
8	Y	400	60	860	205	0.35	2770	35